
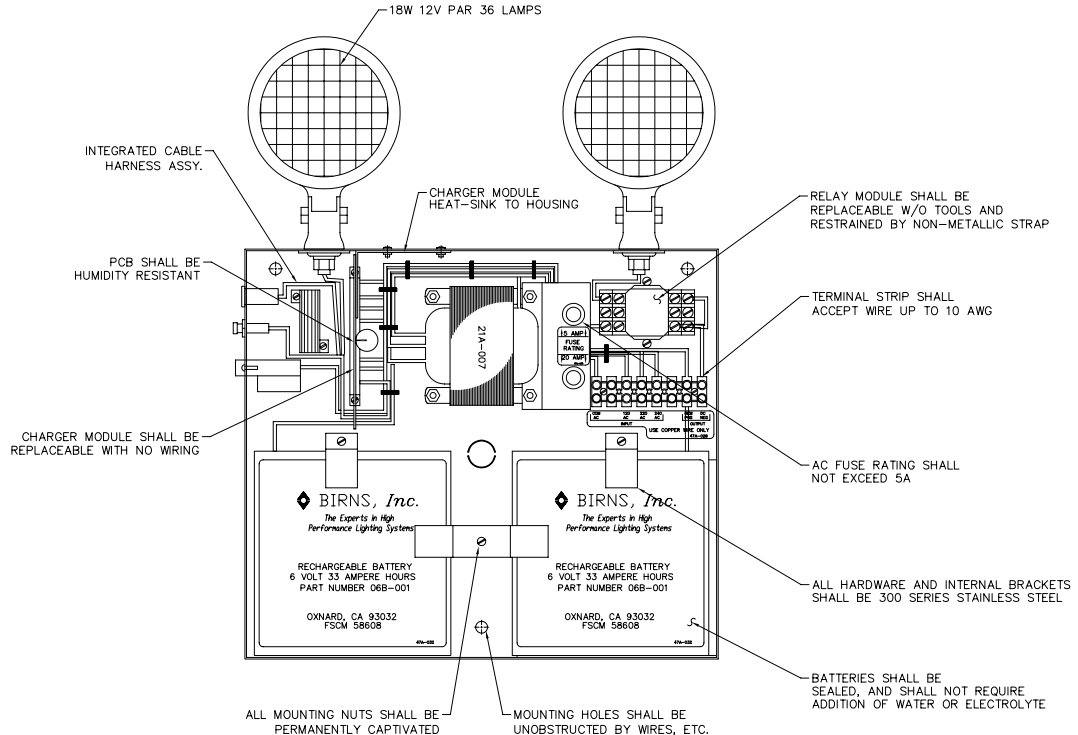


NOTICE  
The information disclosed herein was originated by and is the property of BIRNS, Inc. Except for uses which may be expressly granted, BIRNS, Inc. reserves all patent, proprietary, design, use, sale, manufacturing and reproduction rights in and to said information and this document.

REVISIONS				
ZONE	LTR	DESCRIPTION	DATE	APPROVED
ø		INITIAL DRAWING RELEASE	941111	E.BIRNS

NOTES:

1. ALL WIRE CONNECTIONS SHALL BE FULLY INSULATED; WIRE NUTS NOT ACCEPTABLE.
2. NO SHARP EDGES IN ANY EXPOSED AREA.
3. FIXTURE SHALL BE DESIGNED AND TESTED IAW UL 924.
4. FIXTURE SHALL BE SEISMICALLY QUALIFIED IAW KEPKO SPEC. 9-173-E721.
5. FIXTURE SHALL PROVIDE MIN 8 HRS EMERGENCY ILLUMINATION.

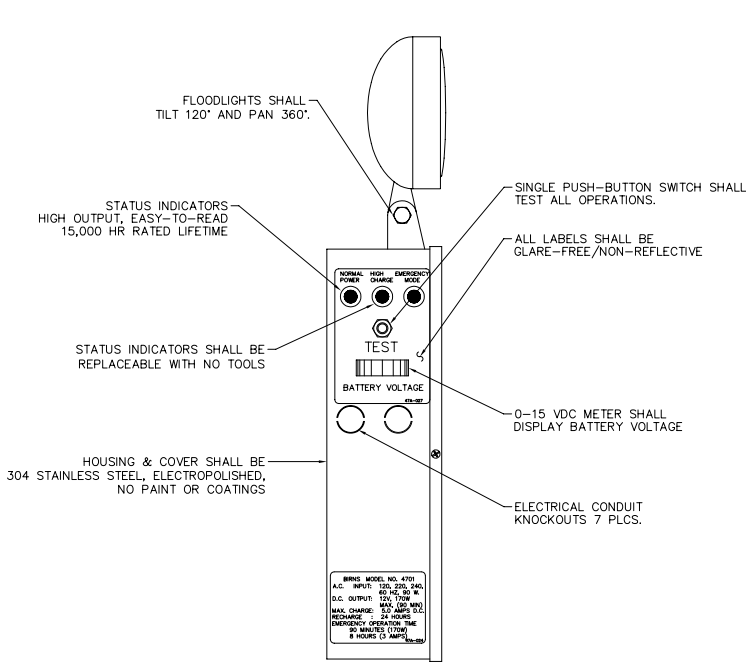

MATERIAL	TREATMENT	FINISH	NEXT ASSY	USED ON	APPLICATION	UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES ALL DIMENSIONS TO APPLY AFTER PLATING		CONTRACT NUMBER			
						.000 ——— ±.005	.00 ——— ±.010	DRAWN	DATE	BIRNS, Inc. Tel: 805-487-5393 Main Plant: 1720 FISKE PLACE, OXNARD CA, 93033	
						.0 ——— ±.015	.0 ——— ±.015	CHECK	DATE		
						FRACTIONS ± 1/32	ANGULAR ± 1/2°	ENGR.	DATE	TITLE FEATURES & SPECIFICATIONS, BIRNS EMERGENCY LIGHT, MODEL 4701	
DRILLED HOLES UP TO 1/2" ± .005 - .001	BREAK SHARP EDGES .005-.015	QA	DATE	SIZE	CAGE CODE	DWG NO.	SCALE	UNIT WT.	LB.	SH. WT.	
FILLET RADI TO BE .015		APPROVED	DATE	D	58608	4701-01-11	1/2		46 LB.		